



# 2032 ADS PCM V2.3.2 Changes and Approval Items

December 13, 2022

Tyler Butikofer  
Staff Engineer

# 2032 ADS PCM Updates from V2.3 to V2.3.2

---

- Updated line parameters from solved PF for Boardman to Hemmingway project
- Retired Colstrip 3 in 2025
- Used B-1 profiles for planned wind generation
- Used CISO provided wind profiles for select California wind generation
- Added Clearwater Wind generator at 750 MW


# Clearwater Wind Approval

---

- Was not included in the L&R data submittal
- 350 MW came online in November 2022
- 32HS1 PF includes all 750 MW at buses 623521-623528
- Added in V2.3.2

*Approval Item: Add Clearwater wind project at 750 MW using placement from 32HS1 PF*

# Path 27 IPP DC Project Dead-band Modeling

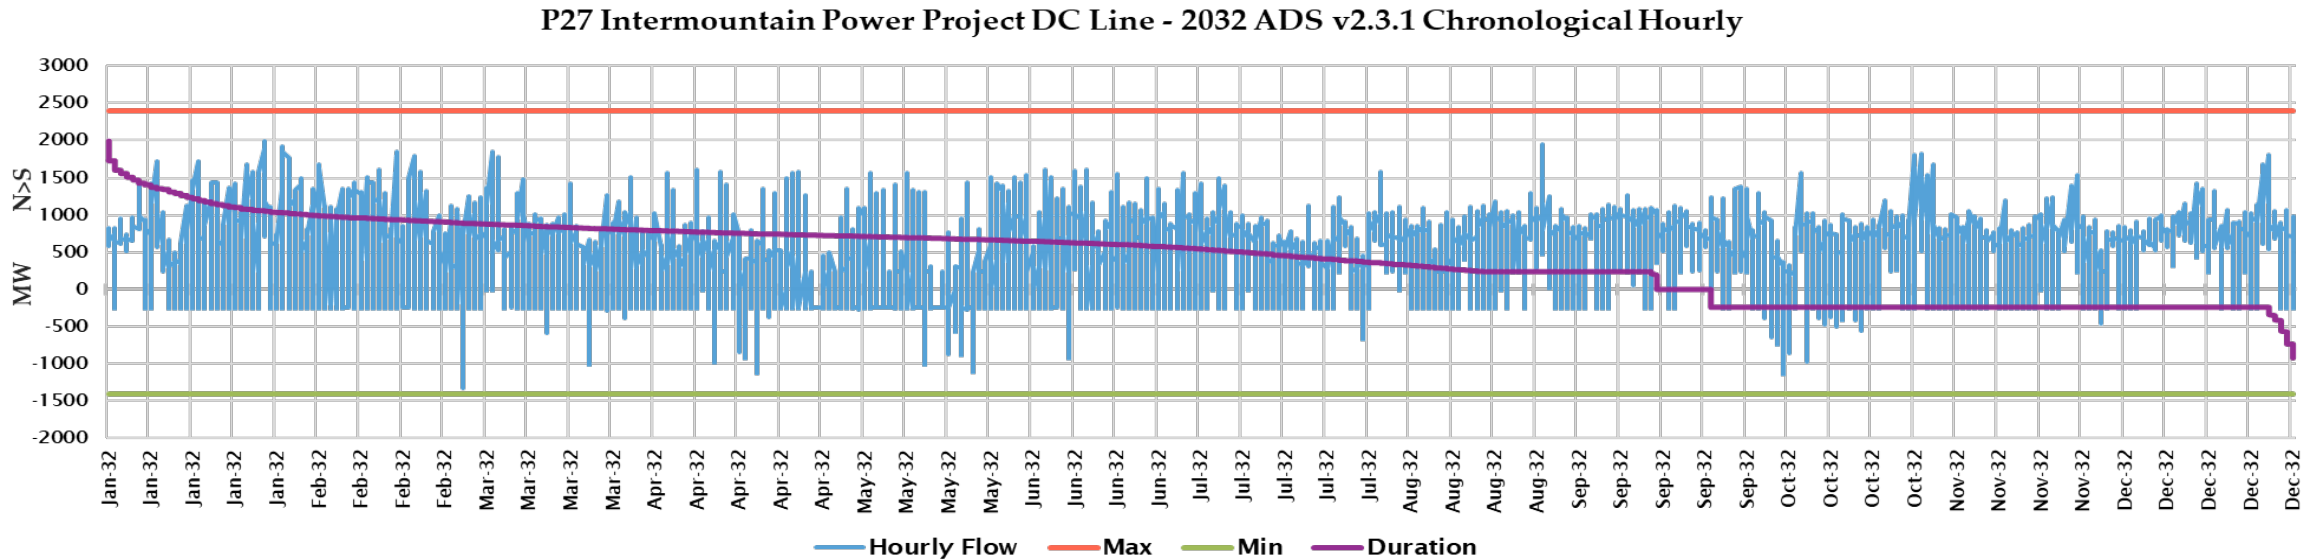

*Approval Item: If flow would be less than 120 MW, round down to zero.*

*If flow greater than or equal to 120 MW, round up to 240 MW.*



## Contact:

Tyler Butikofer

[tbutikofer@wecc.org](mailto:tbutikofer@wecc.org)