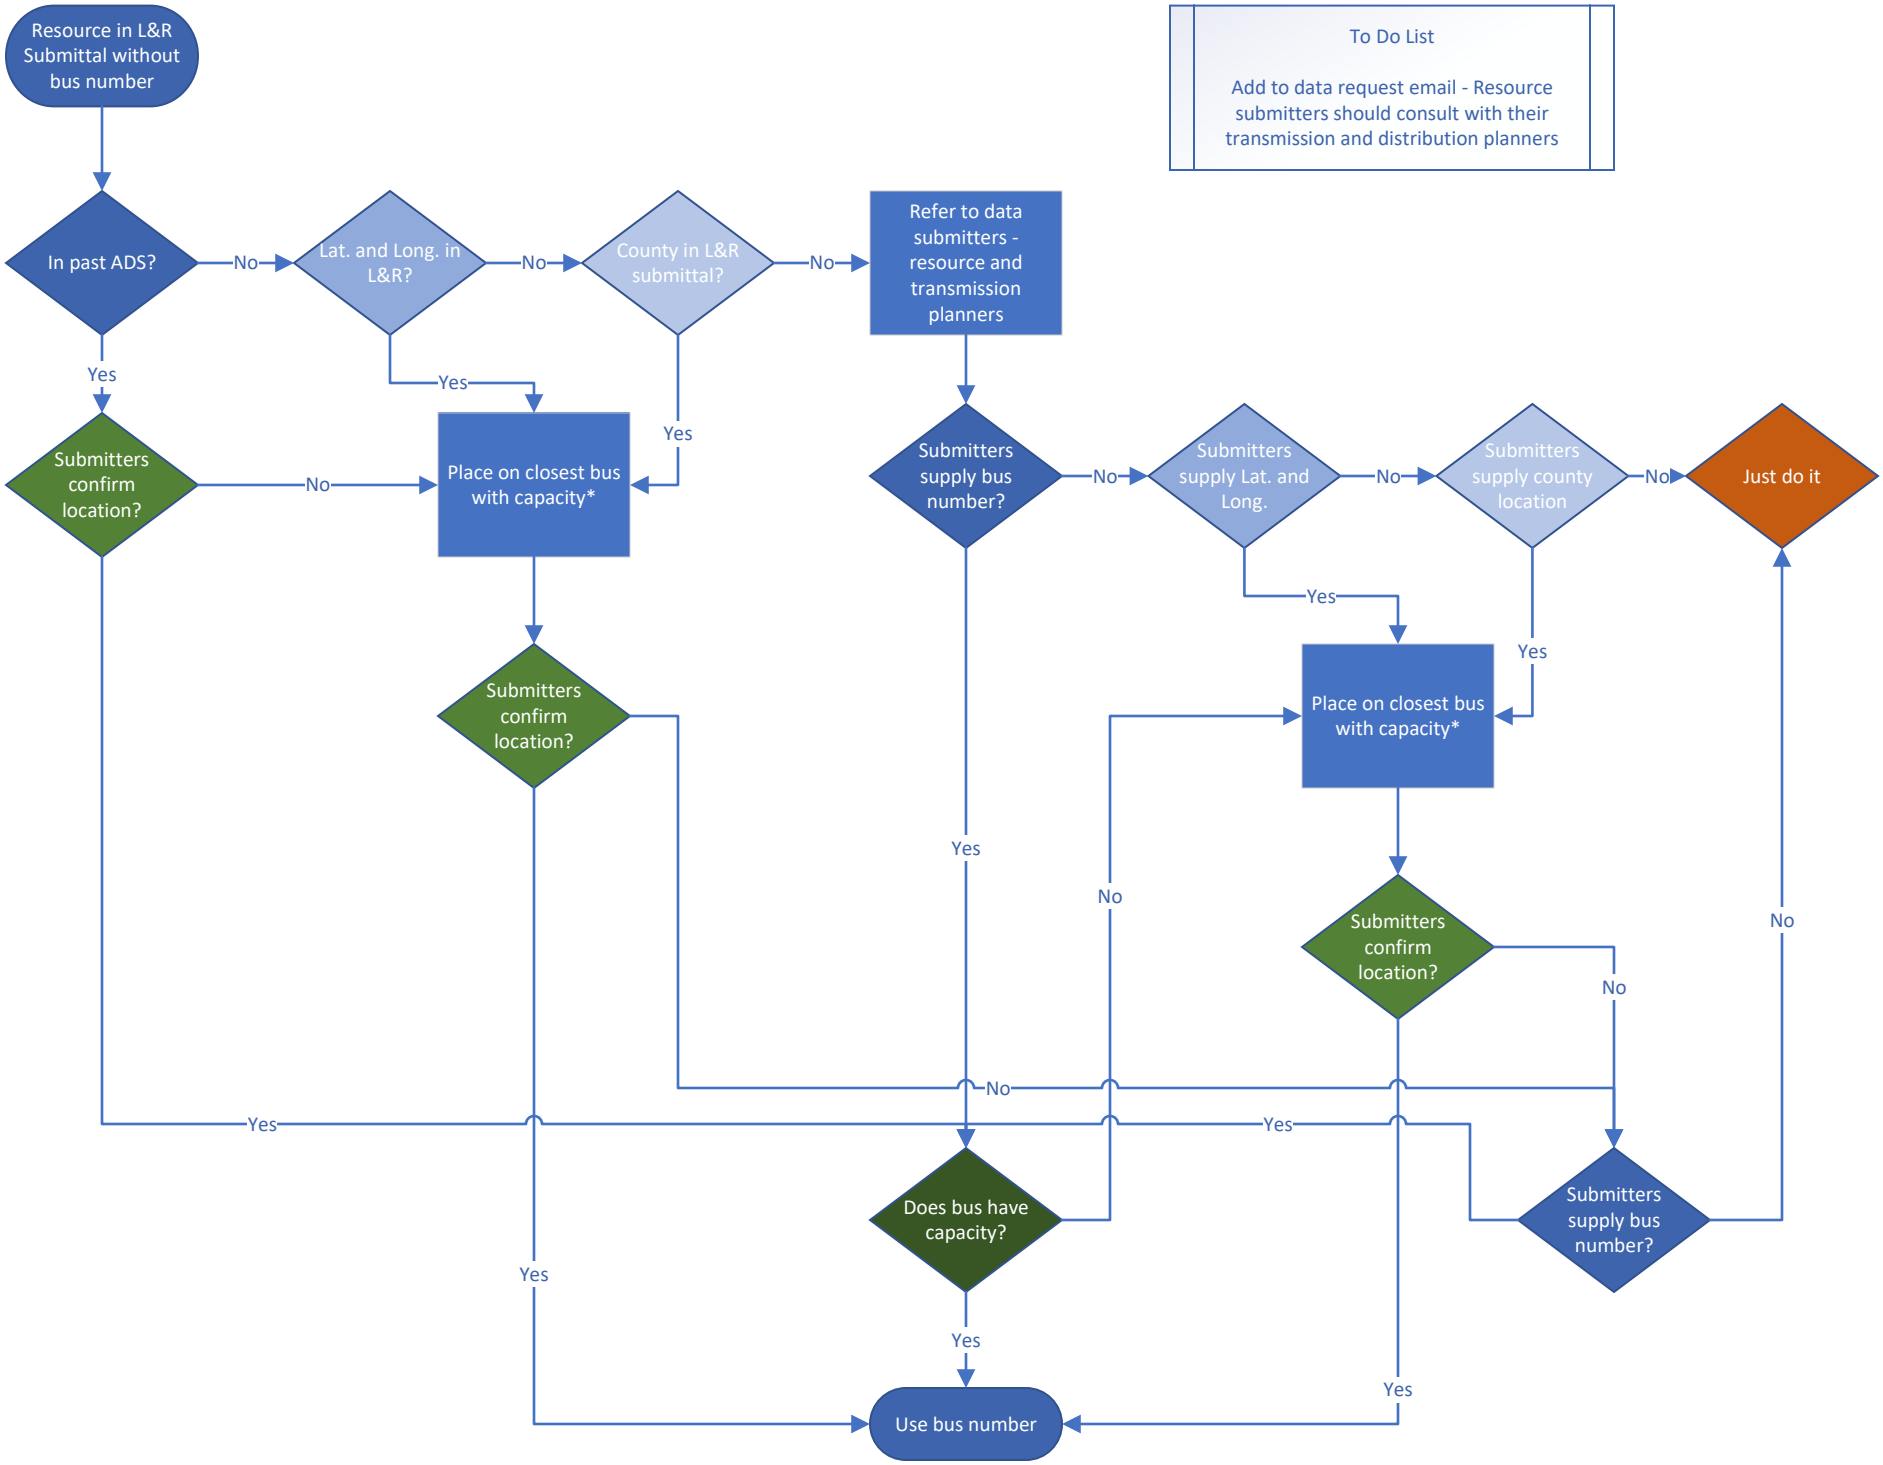
Resource in L&R Submittal without bus number
To Do List
Add to data request email - Resource submitters should consult with their transmission and distribution planners
In past ADS?
No
Lat. and Long. in L&R?
No
County in L&R submittal?
No
Refer to data submitters - resource and transmission planners
Yes
Yes
Yes
Submitters confirm location?
No
Place on closest bus with capacity*
Submitters supply bus number?
No
Submitters supply Lat. and Long.
No
Submitters supply county location
No
Just do it
Yes
Yes
Submitters confirm location?
Place on closest bus with capacity*
Yes
No
Submitters confirm location?
No
No
No
Yes
Yes
Does bus have capacity?
Submitters supply bus number?
Yes
Yes
Yes
Use bus number

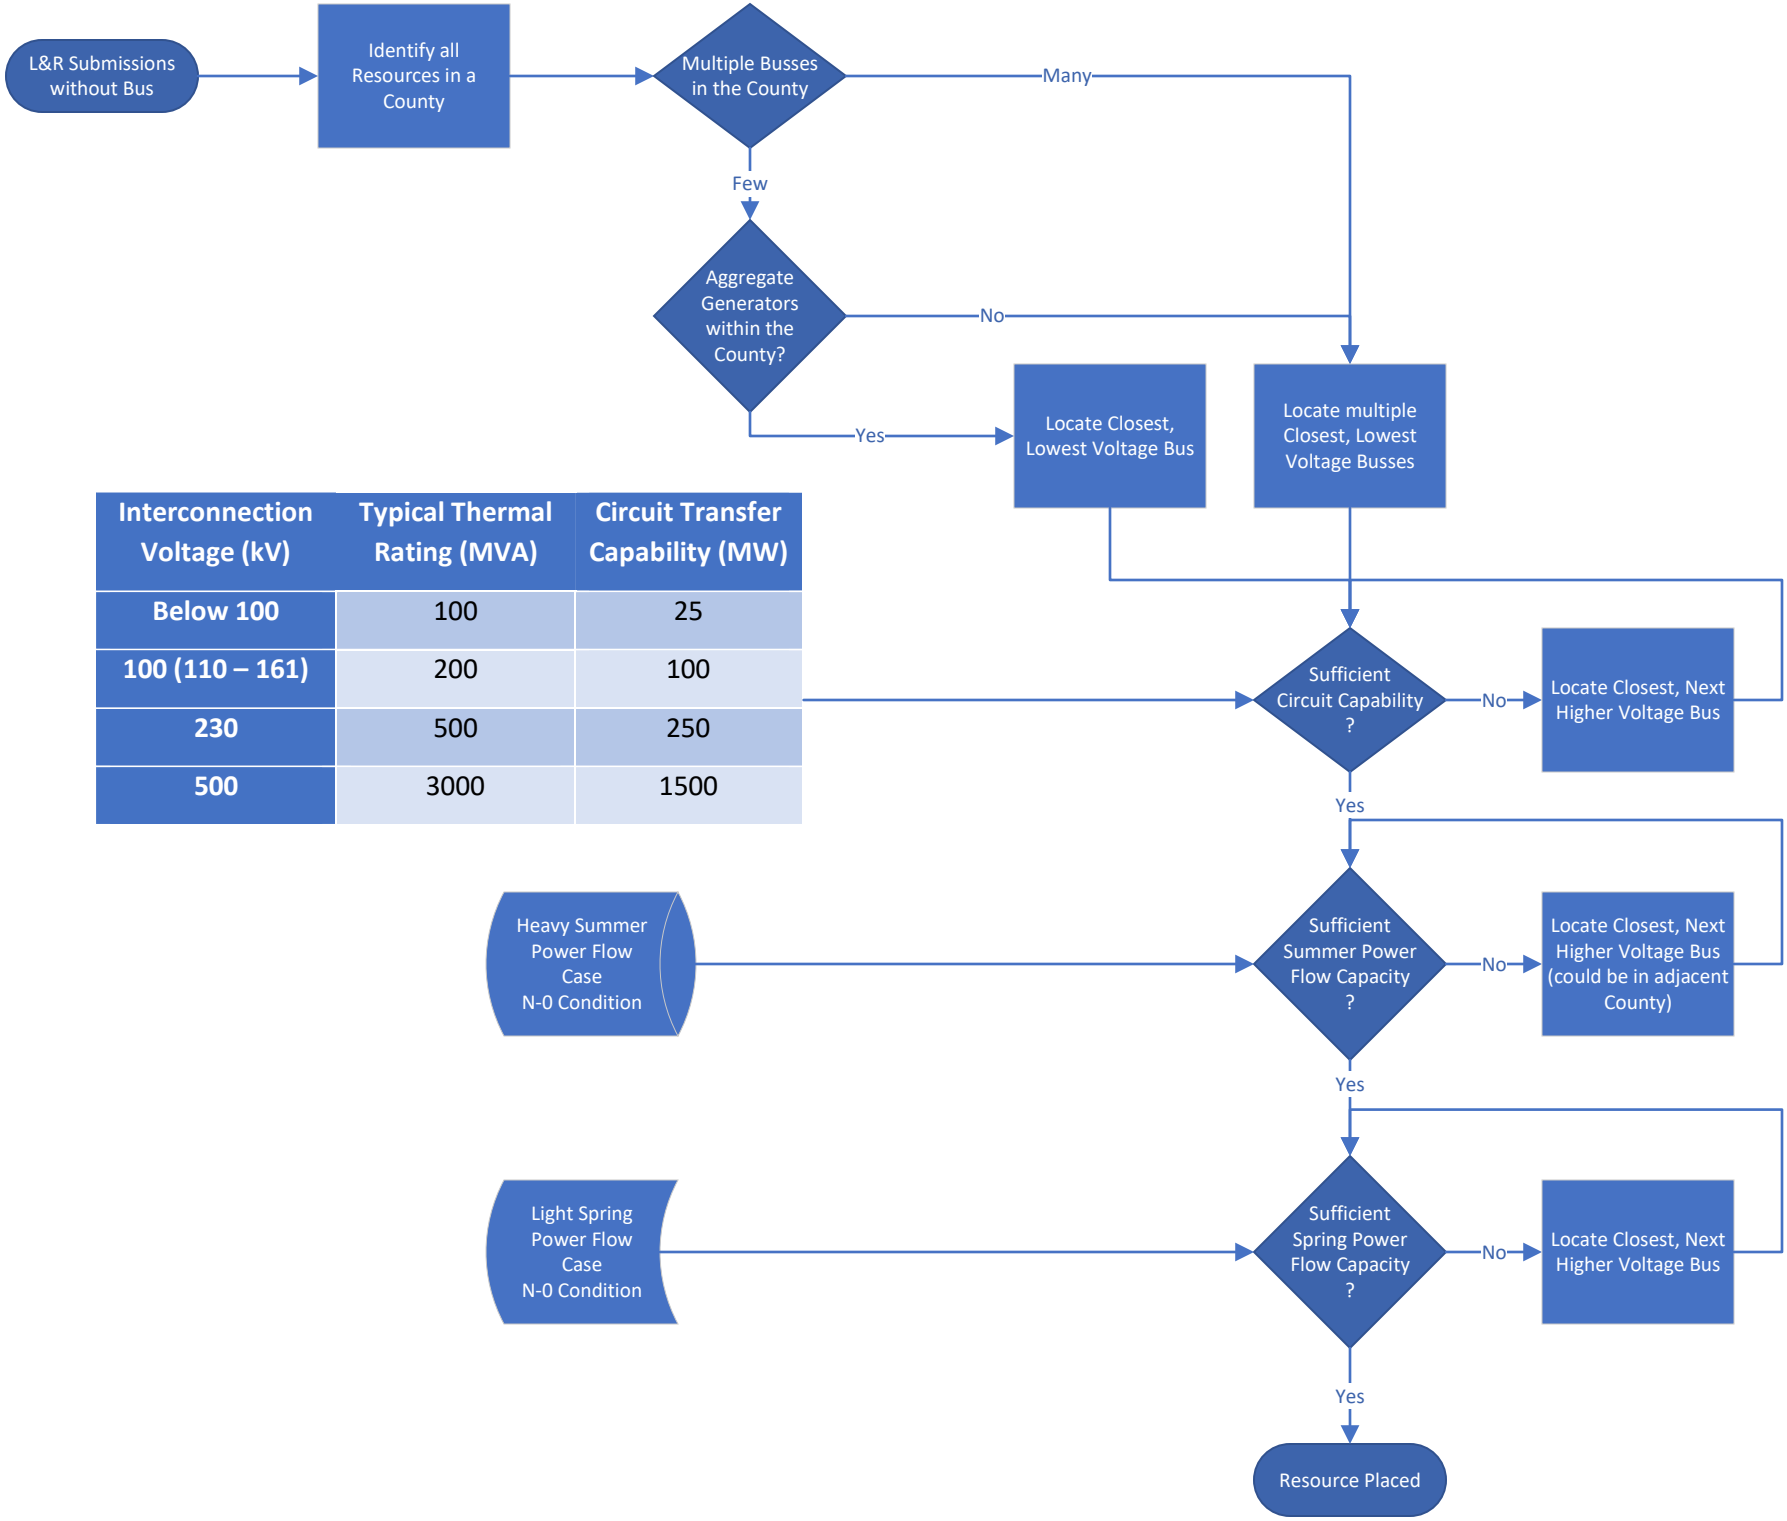


| Interconnection Voltage (kV) | Typical Thermal Rating (MVA) | Circuit Transfer Capability (MW) |
|---|---|---|
| Below 100 | 100 | 25 |
| 100 (110 – 161) | 200 | 100 |
| 230 | 500 | 250 |
| 500 | 3000 | 1500 |